View NSN Online: https://aerobasegroup.com/nsn/5330-00-567-4878

## FLEXITALLIC GASKET CO INC -- ASBESTOS FILLED SPIRAL WOUND GASKET -- 5330-00-567-4878

Product ID: ASBESTOS FILLED SPIRAL WOUND GASKET

MSDS Date:07/09/1986

FSC:5330

NIIN:00-567-4878

MSDS Number: BPJDC === Responsible Party ===

Company Name: FLEXITALLIC GASKET CO INC

Address:6915 LAPORTE RD

Box:760

City:DEER PARK

State:TX ZIP:77536 Country:US

Info Phone Num:713-479-3

491

Emergency Phone Num:713-479-3491

CAGE:58156

=== Contractor Identification ===

Company Name: FLEXITALLIC GASKET CO INC.

Address:6915 LAPORTE RD

Box:760

City:DEER PARK

State:TX ZIP:77536 Country:US

Phone:713-479-3491

CAGE:58156

Company Name: TURBODYNE, DIV OF MCGRAW EDISON CO/DRESSER INDUST.

Address:142 CLINTON RD

Box:City:FAIRFIELD

State:NJ

ZIP:07004-2969 Country:US

Phone:201-227-4565


CAGE:51219

====== Composition/Information on Ingredients ========

Ingred Name: ASBESTOS, CHRYSOT

CAS:12001-29-5 RTECS #:CI6478500
Other REC Limits:NONE RECOMMENDED OSHA PEL:0.2 FIBERS/CC
ACGIH TLV:2 FIBERS/CC; A1;9293
======================================
LD50 LC50 Mixture:PEL FOR ASBESTOS FIBERS 0.2 FIBER/CC Routes of Entry: Inhalation:YES Skin:NO Ingestion:NO Reports of Carcinogenicity:NTP:YES IARC:YES OSHA:YES Health Hazards Acute and Chronic:ACUTE AND CHRONIC- BREATHING OF ASBESTOS FIBERS IN SIGNIFICANT AMOUNTS MAY PRODUCE IRREVERSIBLE
LUNG DISEASE AND CANCER. FREE FIBERS CAN CAUSE EYE AND SKIN IRRITATION. INGESTION IS NOT LIKELY.
Explanation of Carcinogenicity:CONTAINS ASBESTOS.  Effects of Overexposure:BREATHING OF ASBESTOS FIBERS IN SIGNIFICANT AMOUNTS MAY PRODUCE IRREVERSIBLE LUNG DISEASE AND CANCER. FREE FIBERS CAN CAUSE EYE AND SKIN IRRITATION. INGESTION IS NOT LIKELY.  Medical Cond Aggravated by Exposure:PERSONS WITH PRE-EXISTING SKIN DISORDERS OR EYE PROBLEMS OR IMPAIRED RESPIRATORY FUNCTION MAY BE
ORE SUSCEPTIBLE TO THE EFFECTS OF THE SUBSTANCE.
======================================
First Aid:GET MEDICAL ATTENTION IF NEEDED. SKIN:WASH WITH SOAP & WATER. EYE:FLUSH WITH WATER FOR 15 MINUTES, HOLDING EYELIDS OPEN. INHALED:REMOVE TO FRESH AIR. PROVIDE OXYGEN/CPR IF NEEDED. ORAL:CALL A PHYSICIA N.
============= Fire Fighting Measures =============
Extinguishing Media:WATER SPRAY, CARBON DIOXIDE, FOAM OR DRY CHEMICAL FOR SURRO
UNDING FIRE. USE WATER SPRAY TO COOL FIRE EXPOSED CONTAINERS.
======== Accidental Release Measures =========
Spill Release Procedures:VACUUM FIBERS AND DUSTS, CAREFULLY, AVOIDING DUSTING. IF SWEEPING IS USED, CONTROL DUST BY WETTING AND USE APPROPRIATE DUST MASK.
========== Handling and Storage ===========
Handling and Storage Precautions:STORAGE- NOT RELEVANT FOR A FINISHED PRODUCT IN SPIRAL WOUND GASKET. Other Precautions:SEE OTH

ILE

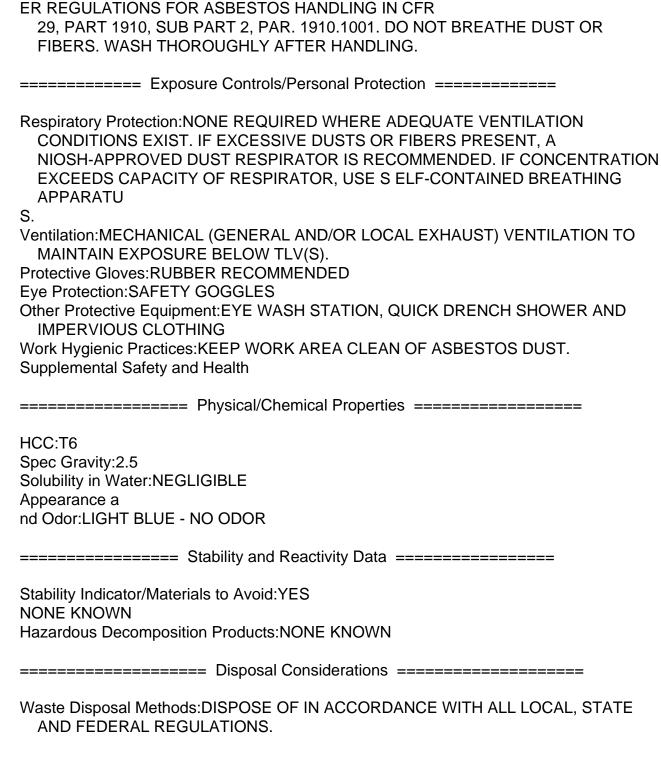

Disclaimer (provided with this information by the compiling agencies): This information is formulated for use by elements of the De

## partment

of Defense. The United States of America in no manner whatsoever, expressly or implied, warrants this information to be accurate and disclaims all liability for its use. Any person utilizing this document should seek competent professional advice to verify and assume responsibility for the suitability of this information to their particular situation.