View NSN Online: https://aerobasegroup.com/nsn/6750-01-379-8379

AGFA DIV OF MILES INC., PHOTO IMAGING SYSTEMS -- 260 PROCESS 44BLS BLEACH STARTER -- 6750-01-379-8379

============= Product Identification ================

Product ID:260 PROCESS 44BLS BLEACH STARTER

MSDS Date:08/01/1993

FSC:6750

NIIN:01-379-8379

MSDS Number: CCJGX === Responsible Party ===

Company Name: AGFA DIV OF MILES INC., PHOTO IMAGING SYSTEMS

Address:100 CHALLENGER RD

City:RIDGEFIELD PARK

State:NJ ZIP:07660

C

ountry:US

Info Phone Num:201-440-2500/212-971-0260

Emergency Phone Num:303-623-5716/800-424-9300(CHEMTREC)

CAGE:NO558

=== Contractor Identification ===

Company Name: AGFA DIV OF MILES INC., PHOT IMAGING SYSTEMS

Address:100 CHALLENGER RD Box:City:RIDGEFIELD PARK

State:NJ ZIP:07660 Country:US

Phone:201-440-2500/212-971-0260

CAGE:NO558

Company Name: AGFA DIVISION, BAYER CORPORATION

Address:100 CHALLENGER ROAD Box:City:RIDGEFIELD PARK


State:NJ ZIP:07660 Country:US

Phone:201-440-2500

CAGE:0P7P7 Company

Name:BAYER CORP / AGFA DIVISION Address:100 CHALLENGER ROAD Box:City:RIDGEFIELD State:NJ ZIP:07660 Country:US Phone:201-440-2500 CAGE:59735
======= Composition/Information on Ingredients ========
Ingred Name:ETHYLENEDIAMINE-TETRAACETIC ACID (EDTA) (CERCLA) CAS:60-00-4 RTECS #:AH4025000 Fraction by Wt: 15-20% Other REC Limits:NONE RECOMMENDED EPA Rpt Qty:5000 LBS DOT Rpt Qty:5000 LBS
Ingred Name:WATER CAS:7732-18-5 RTECS #:ZC0110000 Fraction by Wt: 70-75% Other REC Limits:NONE RE COMMENDED
======================================
LD50 LC50 Mixture:NONE SPECIFIED BY MANUFACTURER. Routes of Entry: Inhalation:YES Skin:YES Ingestion:YES Reports of Carcinogenicity:NTP:NO IARC:NO OSHA:NO Health Hazards Acute and Chronic:EYE/SKIN CONTACT:MAY CAUSE IRRIT.INHAL:NORMALLY NO PROBLEM,BUT INHAL OF MIST COULD CAUSE RESP IRRIT.INGEST:MAY CAUSE IRRIT OF MUCOUS MEMBRANES OR DIGESTIVE TRACT. CHRONIC:COMPUTERIZED LITERATURE SEARC H OF NAT DATA BASE OF EACH INGRED DIDN'TYEILD ANY CHRONIC EFFECTS ASSOC W/THESE MATLS. Explanation of Carcinogenicity:PER MSDS:CARCINOGENICITY LISTING:NTP/IARC/OSHA:NO. Effects of Overexposure:EYE/SKIN IRRIT. RESPIRATORY IRRIT. IRRIT OF MUCOUS MEMBRANES OR DIGESTIVE TRACT IRRIT. Medical Cond Aggravated by Exposure:NONE SPECIFIED BY MANUFACTURER.
======================================

First Aid:EYE:IMMED FLUSH W/PLENTY OF RUNNING WATER FOR @LEAST 15MINS.OBTAIN ME

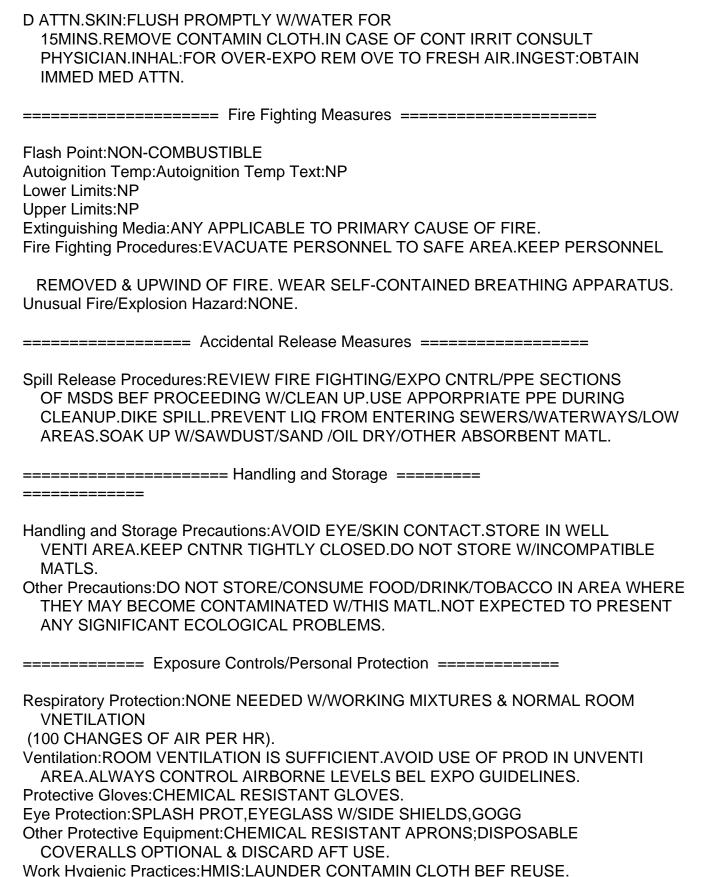

Supplemental Safety and Health

DISPO:OF PERMITTING AUTHORITY & MAY

REQUIRE PRETREATMENT.CERCLA HAZ SUBST:EDTA ACID(RQ=5000LBS).

======================================
HCC:N1 Boiling Pt:B.P. Text:212F,100C Melt/Freeze Pt:M.P/F.P Text:NA Decomp Temp:Decomp Text:NP Vapor Pres:N/ESTIMATE Vapor Density:N/ESTIMATE Spec Gravity:1.128 pH:5.70 Viscosity:NP Evaporation Rate & amp; Reference:N/ESTIMATED Solubility in Water:100% COMPLETE. Appearance and Odor:CLEAR & COLORLESS LIQUID, NO ODOR. Percent Volatiles by Volume:N/ESTI Corrosion R ate:NP
======== Stability and Reactivity Data =========
Stability Indicator/Materials to Avoid:YES STRONG ALKALI, OXIDIZERS. Stability Condition to Avoid:NONE SPECIFIED BY MANUFACTURER. Hazardous Decomposition Products:OXIDES, CO2, CARBON MONOXIDE.
======== Disposal Considerations ===========

Waste Disposal Methods:RECOVER NONUSABLE FREE LIQ &/OR CONTAMIN WATER.DISPO OF IN APPROVED/PERMITTED TREATMENT SYS;INCINERATION RECOMMENDED.REVMOVE NONU

SABLE SOLID MATL &/OR CONTAMIN SOIL FOR DISPO IN APPROVED/PERMITTED LAN DFILL.DISCHARGE TO SEWER REQUIRES APPROVAL (SUPPL)

Disclaimer (provided with this information by the compiling agencies): This information is formulated for use by elements of the Department of Defense. The United States of America in no manner whatsoever, expressly or implied, warrants this information to be accurate and disclaims all liability for its use. Any person utilizing this document should seek com

petent professional advice to verify and assume responsibility for the suitability of this information to their particular situation.