View NSN Online: https://aerobasegroup.com/nsn/6650-01-299-8636

TEXAS INSTRUMENTS INC DEFENSE SYSTEM & ELECTRONICS -- TI 1173 GLASS P/N 794247-0001

-- 6650-01-299-8636

Product ID:TI 1173 GLASS P/N 794247-0001

MSDS Date:06/24/1997

FSC:6650

NIIN:01-299-8636 Status Code:A

MSDS Number: CHXCN === Responsible Party ===

Company Name: TEXAS INSTRUMENTS INC DEFENSE SYSTEM & ELECTRONICS

Address:8505 FOREST LN

Box:660246 City:DALLAS

Sta te:TX

ZIP:75266-0246 Country:US

Info Phone Num:972-917-7749

Emergency Phone Num:972-995-2222 Preparer's Name:ROSS E. JONES

CAGE:96214

=== Contractor Identification ===

Company Name: TEXAS INSTRUMENTS INC DEFENSE SYSTEM & ELECTRONICS

Address:8505 FOREST LN

Box:660246 City:DALLAS State:TX

ZIP:75266-0246 Country:US CAGE:96214

======= Composition/Information on Ingredients ========

Ingred Name: GERMANIUM

CAS:7440-56-4 RTECS #:LY5200000

Other REC Limits: NONE RECOMMENDED

Ingred Name: ANTI


Other REC Limits:NONE RECOMMENDED OSHA PEL:0.5 MG/M3 ACGIH TLV:0.5 MG (SB)/M3; 9596 EPA Rpt Qty:5000 LBS DOT Rpt Qty:5000 LBS
Ingred Name:SELENIUM (SARA 313) (CERCLA) CAS:7782-49-2 RTECS #:VS7700000 Other REC Limits:NONE RECOMMENDED OSHA PEL:0.2 MG/M3 ACGIH TLV:0.2 MG/M3; 9596 EPA Rpt Qty:1 LB DOT Rpt Qty:1 LB
======================================
LD50 LC50 Mixture:NONE SPECIFIED BY MANUFACTURER. Routes of Entry: Inhalation:NO Skin:NO Ingestion:NO Reports of Carcinogenicity:NTP:NO IARC:NO OSHA:NO Health Hazards Acute and Chronic:INHALATION: DECOMPOSITION PRODUCTS ARE POTENTIAL IRRITANTS. SKIN: MAY BE IRRITATING TO SKIN. EYES: DUST IS AN EYE IRRITANT. INGESTED: UNLIKELY IN INDUSTRIAL ENVIRONEMNT. HOWEVER, IF IT IS INGESTED, IT MAY CAUSE GI TRACT DISTRESS, KIDNEY AND LIVER DAMAGE. Explanation of Carcinogenicity:THESE INGREDIENTS ARE NOT LISTED AS CARCINOGENS BY NTP, IARC, O SHA. Effects of Overexposure:EMETIC REACTIUONS, CHILLS, HEADACHE, COUGH, TREMOR, INSOMNIA, IRRITABILITY, WEAKNESS, SALIVATION AND EDEMA OF THE LUNGS. Medical Cond Aggravated by Exposure:NONE KNOWN.
======================================
First Aid-EVES-ELLISH WITH WATER FOR 15 MINILITES SEEK MEDICAL ATTENTION

MONY (SARA 313) (CERCLA)

CAS:7440-36-0

RTECS #:CC4025000

First Aid:EYES-FLUSH WITH WATER FOR 15 MINUTES. SEEK MEDICAL ATTENTION. SKIN-IMMEDIATELY REMOVE CONTAMINATED CLOTHES & SHOES. WASH WITH SOAP & WATER. INHALED-REMOVE TO FRESH AIR. RESTORE BREATHING AS NEEDED. GE

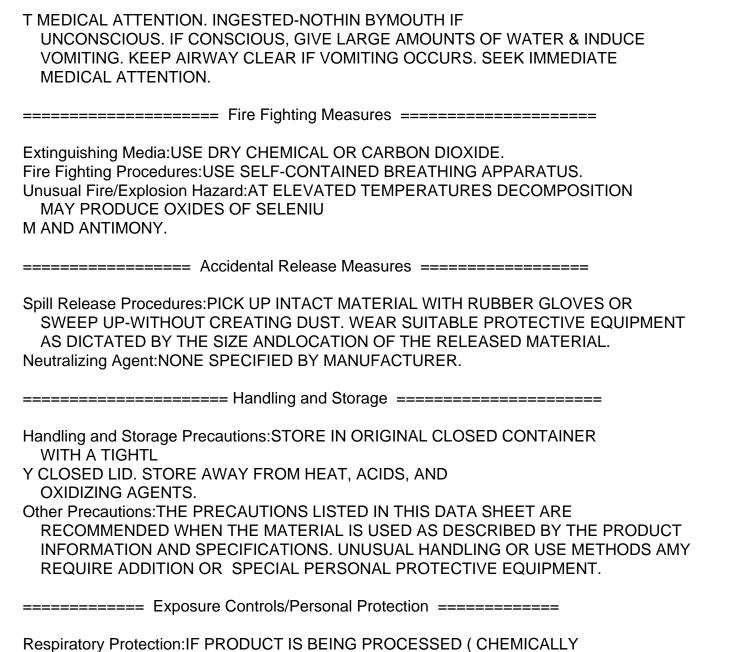

ETCHED, CUT, GROUND,

ABRADED, ETC) NIOSH-APPROVED RESPIRATOR IS

RECOMMENDED FOR PROVIDING PEL (